



Environment, Safety, Health and Quality (ESH&Q) Report


RIDDOR Reportable Incidents

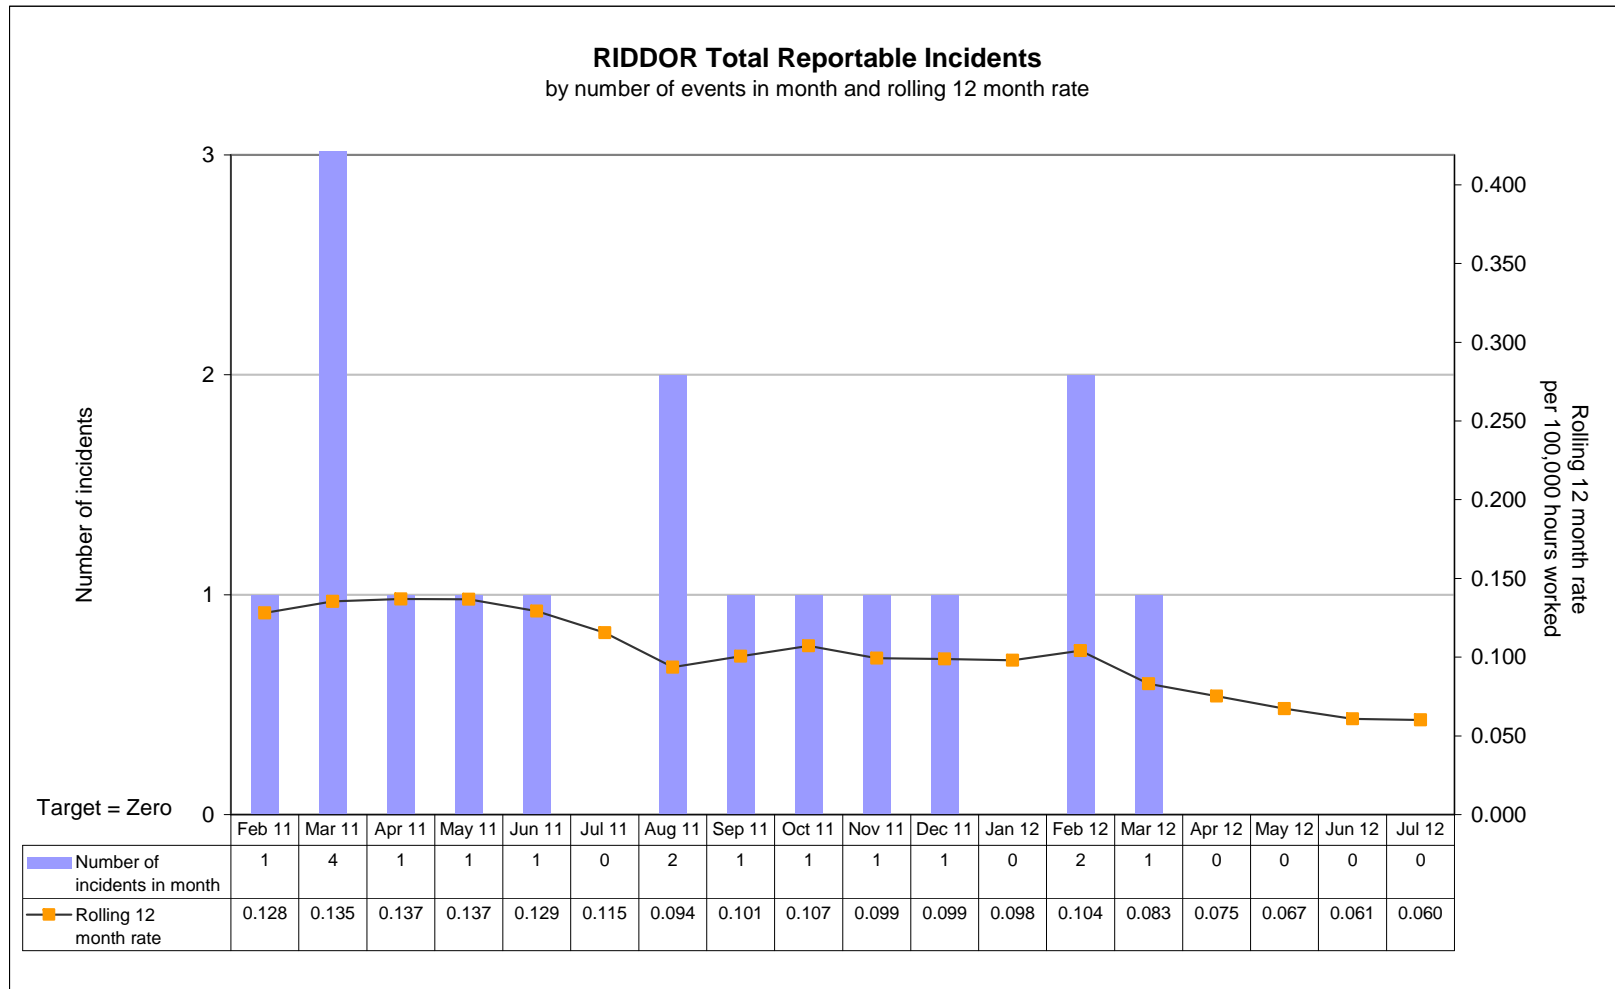


OSHA Recordable Incidents

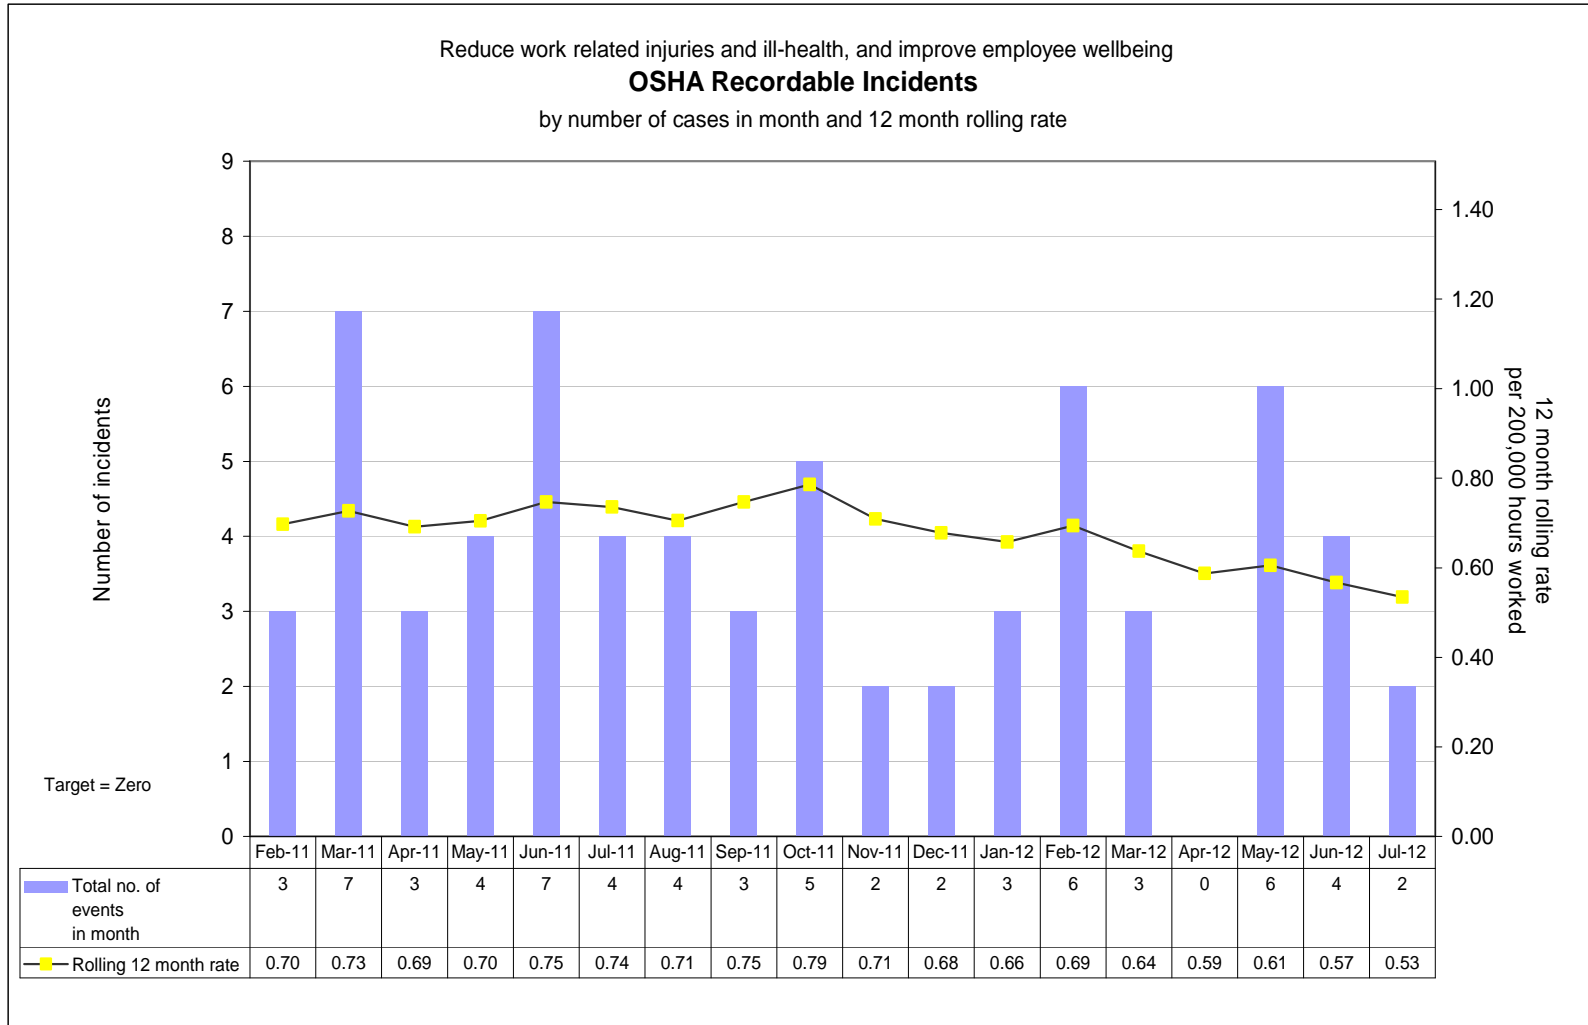


OSHA Days Away Cases

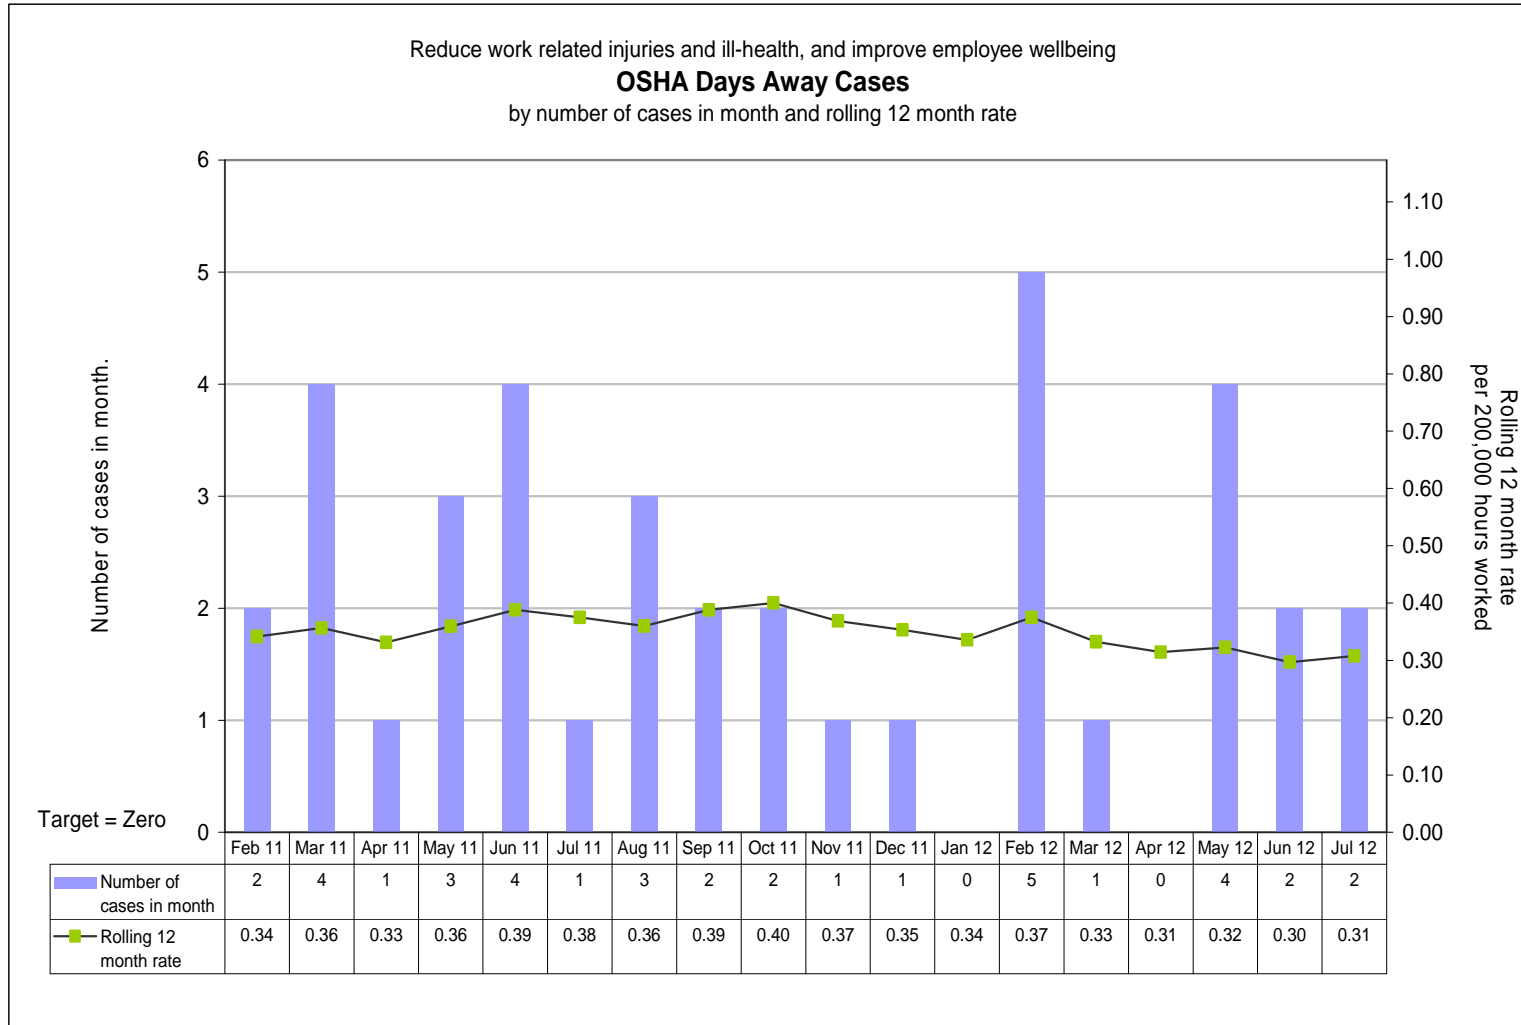

OSHA First Aid Cases

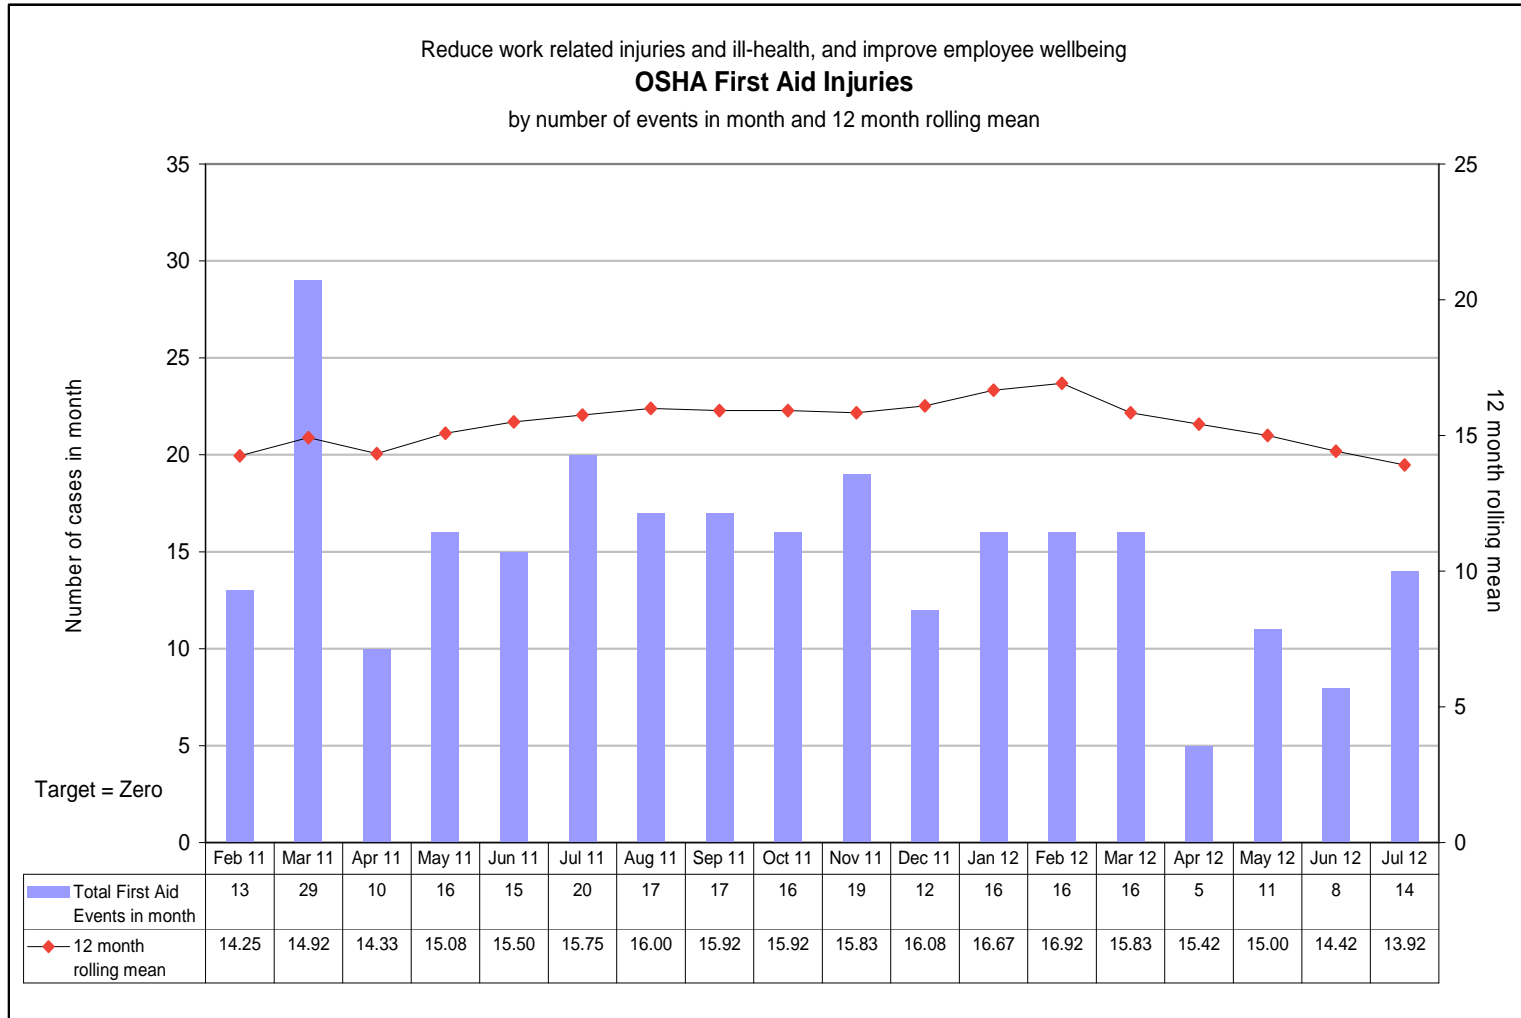

Total Waste Diverted from Landfill

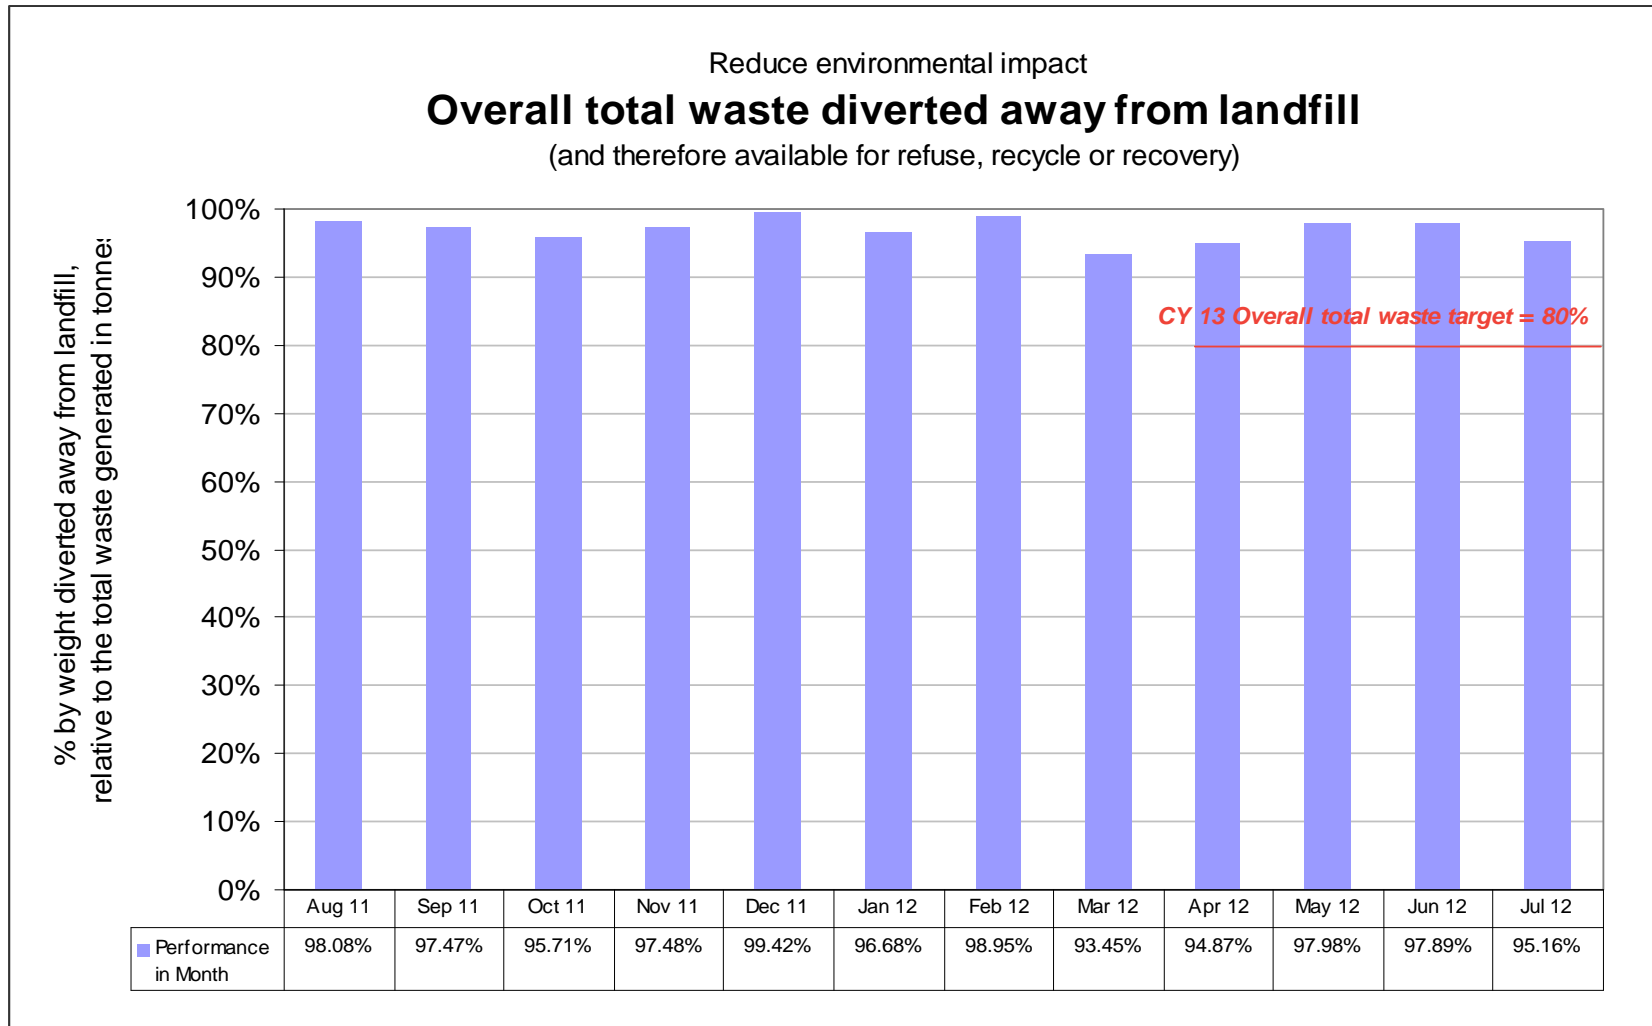

Public Dose Assessment

Discharge	Aldermaston		Burghfield		Guidance Levels
	Q2 2012 Apr–Jun 12	Jul 11 to Jun 12	Q2 2012 Apr–Jun 12	Jul 11 to June 12	
Atmosphere	12 nSv (0.000012 mSv)	110 nSv (0.00011 mSv)	0.3 pSv (0.0000000003 mSv)	1 pSv (0.000000001 mSv)	0.5 mSv
Trade Effluent	8 nSv (0.000008 mSv)	32 nSv (0.000032 mSv)	N/A	N/A	0.5 mSv
Aldermaston Stream	0.1 nSv (0.0000001 mSv)	0.4 nSv (0.0000004 mSv)	N/A	N/A	0.5 mSv

- The calculated doses represent minute fractions of the dose constraint set by the Environment Agency of 0.5 mSv per year for a nuclear site
- The model concludes that there is no hazard to members of the public